



User Manual

True RMS Current Transmitter

PM-CTR11



Version: 1.1

Release Date: 01/30/2023

Contents

1	INTRODUCTION	3
1.1	Purpose of the manual	3
1.2	Technical knowledge required	3
1.3	Manual validation	3
1.4	technical support.....	3
2	SAFETY TIPS.....	4
3	DESCRIPTION.....	4
3.1	Basic description	4
3.2	Technical Specifications.....	4
3.3	Module dimensions.....	5
4	INSTALLATION	6
4.1	Observe EMC items	6
4.2	Cases that cause system malfunctions.....	6
4.3	Things to consider	6
5	CONNECTIONS	7
5.1	Connections group	7
5.2	Power supply connection	7
5.3	Current input (connection to current transformer).....	8
5.4	RS485 connection	8
6	PARAMETERS	10
6.1	communication parameter.....	10
6.2	Module information parameter.....	11
6.3	Parameters of current digital values.....	11

1 Introduction

1.1 Purpose of the manual

This manual contains all the information needed to set up, install, wiring and communicate with the PM-CTR11A module.

1.2 Technical knowledge required

In order to understand this booklet, a basic acquaintance with electrical topics is required.

1.3 Manual validation

This booklet is valid for this specification.

MODEL	Hardware	Software
PM-CTR11A	V1.1	V1.1

1.4 technical support

To get technical support through the following contact:

- ❖ Email: info@parsmega.com
- ❖ Phone: +98 21 91009955
- ❖ WhatsApp: +98 9981122566

2 safety tips

- Starting the module by non-experts and ignoring the commands may cause serious damage to the module.
- This module does not directly pose a risk to human life.
- The use of this module is not approved for use in life-threatening devices.

3 Description


3.1 Basic description

PM-CTR11 is a CT current transformer converter with digital value. This module has the ability to measure currents with different waveforms (waveforms with different cutting types) by using a True RMS converter chip, and by default it can be connected to the transformer. The output current is 5 amps. This module has the ability to connect to the computer and control equipment such as (HMI and PLC) through the RS485 serial port.

3.2 Technical Specifications

- Wide range of port 485 baud rate (from 2400 to 230400)
- Module status LED Indicator
- 10-bit Analog to Digital converter
- 1 CT input
- Working temperature range: -30 ~ +75 degrees Celsius
- RS485 serial communication with MODBUS protocol support

3.3 Module dimensions

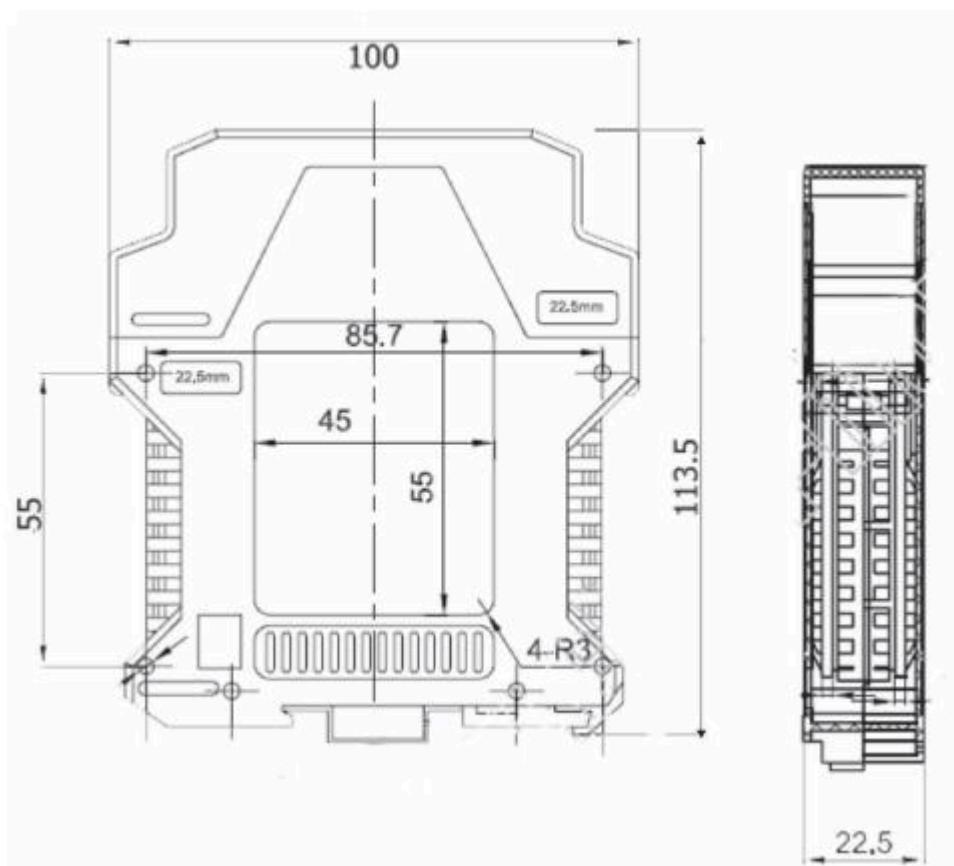

4 Installation

4.1 Observe EMC items

This product is designed and manufactured to work in industrial environments. However, for proper operation, you should check and eliminate the issues that cause the module to malfunction.

4.2 Cases that cause system malfunctions

- Electromagnetic field
- Telecommunication cables

4.3 Things to consider

4.3.1 Convenient ground connection

- When installing the module on the panel body, make sure that the panel body is connected to the ground.
- All ineffective metal parts are (firmly) grounded.
- When connecting varnished wires to ground connection, remove the varnish from that part.

4.3.2 Appropriate wiring method


- Divide your system cables into different groups (high voltage, power supply, and signal, analog).
- Always transfer the power cable from another duct.
- Always place your analog cables close to the body of the panel and rails (which are grounded).

4.3.3 Cable shield connection

- Make sure the shields are properly grounded.
- Try to keep a small part of the cable without a shield.

5 connections

All connections of this module are screws.

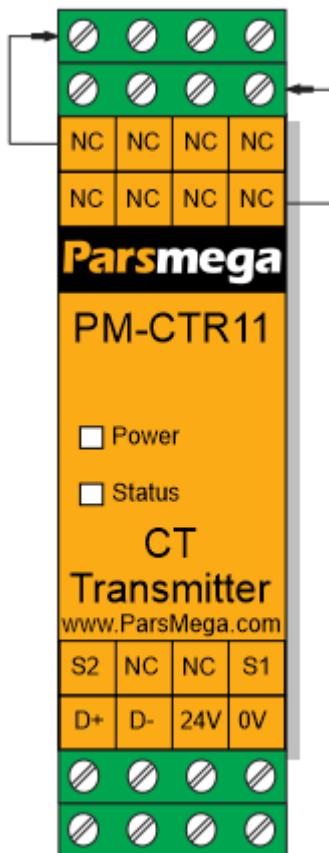

5.1 Connections group

The connections of this module include 4 main groups :

- Power
- Current input (connection to current transformer)
- Analog output
- RS485 serial

5.2 Power supply connection

The proper power supply for this module is 24 v dc, otherwise the device will not function properly.


Terminal 0 V

terminal 24 V

5.3 Current input (connection to current transformer)

The PM-CTR11 module has the ability to connect to the output of a current transformer (by default, a transformer with an output of 5 amps). The labels of the terminals as well as the function corresponding to each terminal are as follows:

Label	Function
S1	Input number one of the current transformer(COM)
S2	Input number two current transformer

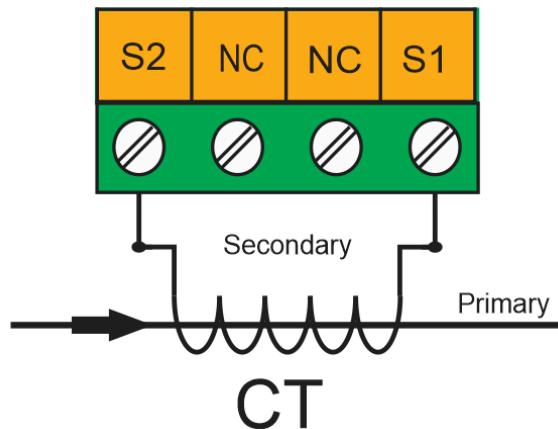


5.4 RS485 connection

This module is equipped with an RS485 serial port on which the MODBUS RTU protocol is implemented.

Label	Function
D+	Positive data
D-	Negative data

Below is how to connect the power supply and serial port to the module:

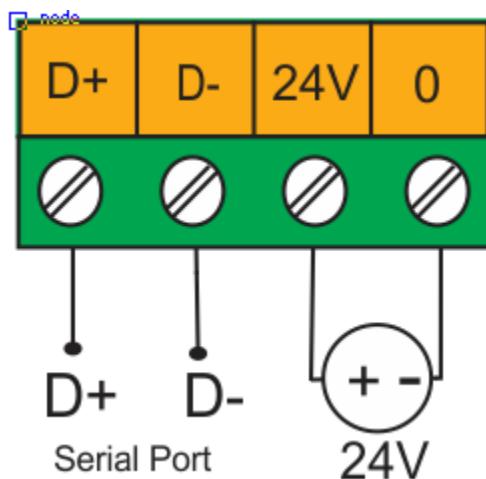

6 parameters

All parameters are set with default values at the time of purchase.

For ease of work, the parameters are divided into different groups.

- The length of all variables is word
- Some parameters need to be restarted to apply changes.

6.1 communication parameter

Title	Variable type	length	Reading writing	Address	explanation	Default
ID	Unsigned int	1	R/W	0 40001	1~247	1
Baud Rate	Unsigned int	1	R/W	1 40002	0~10 0=2400 1=4800 2=9600 3=14400 4=19200 5=28800 6=38400 7=57600 8=76800 9=115200 10=230400	2
parity	Unsigned int	1	R/W	2 40003	0=none 1=odd 2=even	2
Stop bit	Unsigned int	1	R/W	3 40004	0=1 1=2	0
Comm Mode	Unsigned int	1	R/W	4 40005	0=RTU 1=ASCII(8bit) 2=ASCII(7bit)	-

Note that the converter is reset once to apply the above parameters .

6.2 Module information parameter

All the following parameters are read only

Title	Variable type	length	/Read Write	Address	Description	Default
Firmware ver	Float	2	R	6 40007		
Hardware ver	Float	2	R	8 40009		
Model	Unsigned int	1	R	10 40011		
Serial number	Unsigned long	2	R	11 40012		

6.3 Parameters of current digital values

Title	Variable type	length	/Read Write	Address	Description	Default
ADC raw data	Unsigned int	1	R	14 40015	0~1023	
			R			

ADC raw data parameter displays the converted value of 0-5A current as 0-1023.